



Test Report issued under the responsibility of:



**TEST REPORT
IEC 60269-3**

Low-voltage fuses

Part 3: Supplementary requirements for fuses for use by unskilled persons (fuses mainly for household and similar applications) - Examples of standardized systems of fuses A to F

Report Reference No.: 2.03.02253.1.0/EZV25GS+EZR25GS/CB/CCA
Date of issue.....: 10.04.2012
Total number of pages: 55

CB Testing Laboratory.....: ÖFPZ Arsenal Ges.m.b.H.
Address: A-1210 Vienna, Giefinggasse 2, AUSTRIA

Applicant's name.....: ETI Elektroelement d.d.
Address: SI-1411 Izlake, Obrezija 5, SLOVENIA

Test specification:

Standard: IEC 60269-3:2006 (Third edition) (see also IEC 60269-1:2006)
Test procedure: CB
Non-standard test method.....: N/A

Test Report Form No.: IEC60269_3B

Test Report Form(s) Originator: EZU
Master TRF.....: Dated April 2009




Copyright © 2009 IEC System for Conformity Testing and Certification of Electrical Equipment (IECEE), Geneva, Switzerland. All rights reserved.

This publication may be reproduced in whole or in part for non-commercial purposes as long as the IECEE is acknowledged as copyright owner and source of the material. IECEE takes no responsibility for and will not assume liability for damages resulting from the reader's interpretation of the reproduced material due to its placement and context.

If this Test Report Form is used by non-IECEE members, the IECEE/IEC logo and the reference to the CB Scheme procedure shall be removed.

This report is not valid as a CB Test Report unless signed by an approved CB Testing Laboratory and appended to a CB Test Certificate issued by an NCB in accordance with IECEE 02.

Test item description: D-type fuse-base
Trade Mark: ETI
Manufacturer: ETI Elektroelement d.d.
Model/Type reference: EZV 25 GS (002322028), EZR 25 GS (002322027)
Ratings: 500V / 25A

Testing procedure and testing location:	
<input checked="" type="checkbox"/> CB Testing Laboratory: Testing location/ address: ÖFPZ Arsenal Ges.m.b.H., Giefinggase 2, A-1210, Vienna <input type="checkbox"/> Associated CB Test Laboratory: Testing location/ address: --- Tested by (name + signature): Ing.J.Ainetter Approved by (name + signature).....: Ing.K.Farhofer	  
<input type="checkbox"/> Testing procedure: TMP Tested by (name + signature): --- Approved by (+ signature).....: --- Testing location/ address: ---
<input type="checkbox"/> Testing procedure: WMT Tested by (name + signature): --- Witnessed by (+ signature): --- Approved by (+ signature).....: --- Testing location/ address: ---
<input type="checkbox"/> Testing procedure: SMT Tested by (name + signature): --- Approved by (+ signature).....: --- Supervised by (+ signature): --- Testing location/ address: ---
<input type="checkbox"/> Testing procedure: RMT Tested by (name + signature): --- Approved by (+ signature).....: --- Supervised by (+ signature): --- Testing location/ address: ---

Summary of testing:**Tests performed:**

A type test was performed according to

- IEC 60269-1 Ed. 4.1:2009
- EN 60269-1:2007 + A1:2009

and

- IEC 60269-3 Ed. 4.0:2010
- HD 60269-3:2010.

The fuse-bases

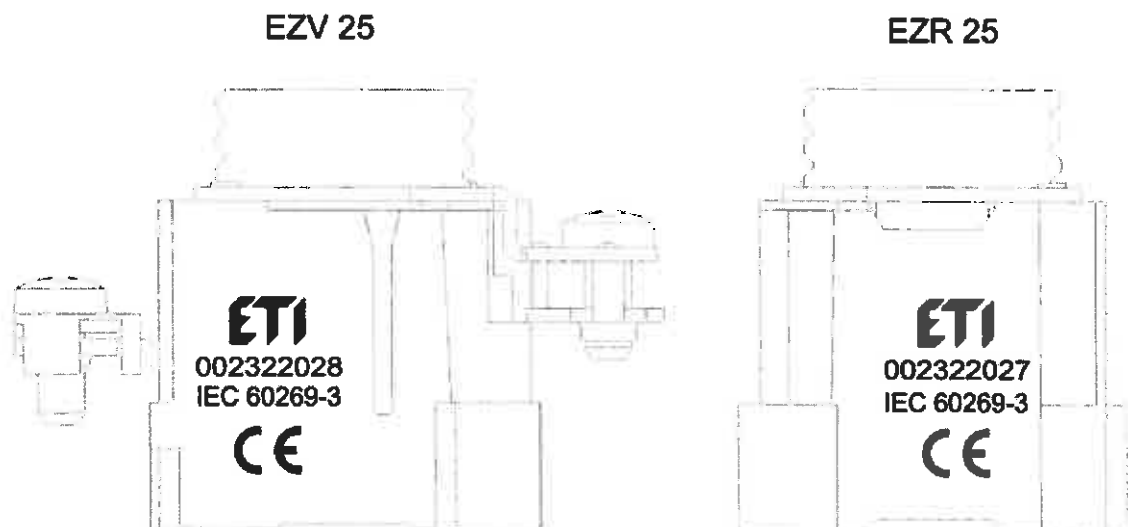
- EZV 25 GS and EZR 25 GS

have passed the type test successfully.

Testing location:

ÖFPZ Arsenal Ges.m.b.H.
Business Unit Electric Energy Systems
Power Service Center
Giefinggasse 2
A-1210 Vienna

The ÖFPZ Arsenal Ges.m.b.H. is a recognized
CB/CCA Testing Laboratory under the responsibility
of OVE as the National Certification Body.

Summary of compliance with National Differences:**Copy of marking plate:**

Ratings:	
Identification reference	EZV 25 GS: 002322028 EZR 25 GS: 002322027
Nature of supply	AC, DC
Size	DII
Utilization category	-
Rated current	25A
Rated voltage	500V
Rated frequency	45Hz to 62Hz, DC
Rated breaking capacity	50kA a.c., 8kA d.c.
Homogeneous series	-
Type of terminals	Pillar terminals
Material of contacts	CuZn37 gal. Ni
Material of fuse-link body	-
Extinguishing means	-
Test item particulars:	
Classification of installation and use	Acc. to IEC 60269-3 and HD 60269-3
Supply Connection	Acc. to IEC 60269-3 and HD 60269-3
Fuse system.....	A
Possible test case verdicts:	
- test case does not apply to the test object	N/A
- test object does meet the requirement	P (Pass)
- test object does not meet the requirement	F (Fail)
Testing:	
Date of receipt of test item.....	06/2011
Date (s) of performance of tests.....	06/2011 to 09/2011
General remarks:	
The test results presented in this report relate only to the object tested.	
This report shall not be reproduced, except in full, without the written approval of the Issuing testing laboratory.	
"(see Enclosure #)" refers to additional information appended to the report.	
"(see appended table)" refers to a table appended to the report.	
Throughout this report a comma is used as the decimal separator.	

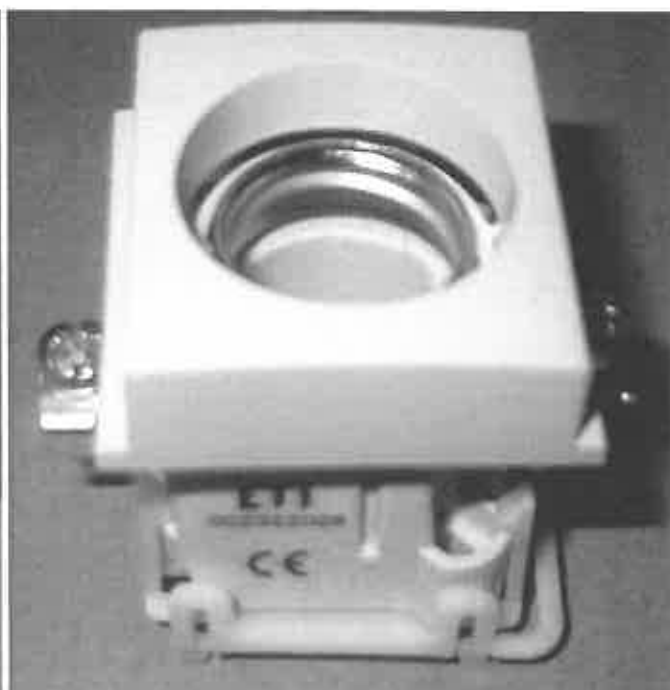
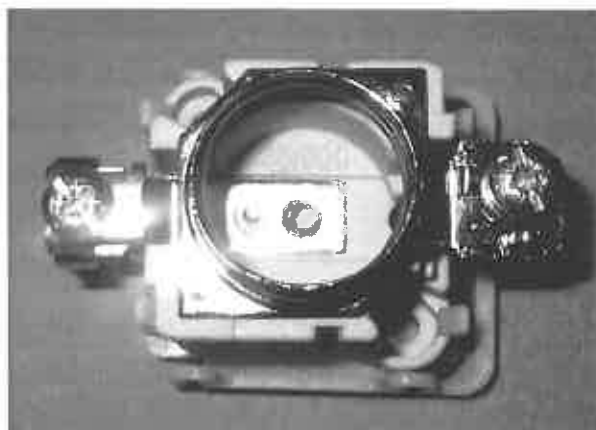
General product information:

Reference numbers:

- EZV 25 GS: 002322028
- EZR 25 GS: 002322027

Photos of products:

- EZV 25 GS



Photos of products (continued):

- EZR 25 GS

